

4" DIA. SCHED. 40 PIPE W/ SLOPED MTL. CAP ON TOP. MAXIMUM 6'-0" O.C. SPACING. SET POST IN CONC. FOOTING.

6" DIA. STEEL PIPE. 8' LONG, FILLED W/ CONCRETE. TOP OF PIPE: 4" ABOVE SLAB. (2) REQUIRED FOOTING: 1'-6" DIA. X 4'-6" DEEP. BOLLARDS SHALL BE PLACED FAR ENOUGH BACK TO ALLOW THE FULL DEPTH OF THE ANTICIPATED DUMPSTER BIN AND ANY ADDITIONAL SPACE NEEDED TO PREVENT DUMPSTER BIN(S) FROM CONFLICTING WITH ANY OTHER CITY REQUIREMENTS.

6" CONCRETE SLAB W/ #4 REBAR @ 2'-0" O.C. EACH WAY

SCREENING MATERIAL, AS REQUIRED BY CURRENT ORDINANCE(S).

STRUCTURAL GATE AND GATE SUPPORTS (OR POST) SHALL BE DESIGNED BY A REGISTERED CERTIFIED PROFESSIONAL.

GATES (OPTIONAL) SHALL INCLUDE FEATURES THAT SECURE GATES IN AN OPEN POSITION WHILE THE COLLECTION VEHICLE IS EMPTYING THE CONTAINER.



6" CONCRETE APPROACH APRON W/ #4 REBAR @ 2'-0" O.C. EACH WAY

12" X 12" THICKENED EDGE

MATCH DUMPSTER PAD WIDTH (14' MIN.)

TABLE 1: OPENING WIDTH		
1 UNITS	13'-4"	
2 UNITS	26'-4"	
>2 UNITS	APPROVAL BY CITY	

- NOTE:**
1. ALTERNATIVE DESIGNS MUST MEET THESE MINIMUM REQUIREMENTS AND SHALL BE APPROVED BY THE CITY.
 2. ALL APPROACHES AND CLEARANCES TO THE PAD SHALL BE APPROVED BY THE DIRECTOR OF SOLID WASTE OR HIS/HER REPRESENTATIVE.
 3. DUMPSTER PAD LOCATION(S) AND SPECIFICATIONS SHALL MEET THE MINIMUM REQUIREMENTS OF CHAPTER 24 OF THE CITY OF KILLEEN CODE OF ORDINANCES.
 4. DRAINAGE INFRASTRUCTURES SHALL NOT HAVE CONCENTRATED RUNOFF OR DISCHARGE ALLOWED TO FLOW THROUGH OR IN CLOSE PROXIMITY OF THE DUMPSTER AREA IN SUCH A WAY AS TO CREATE AN ILLICIT DISCHARGE. ANY ILLICIT DISCHARGE(S) SHALL BE ADDRESSED BY ADOPTED CITY OF KILLEEN CODES AND ENFORCEMENT ACTION.

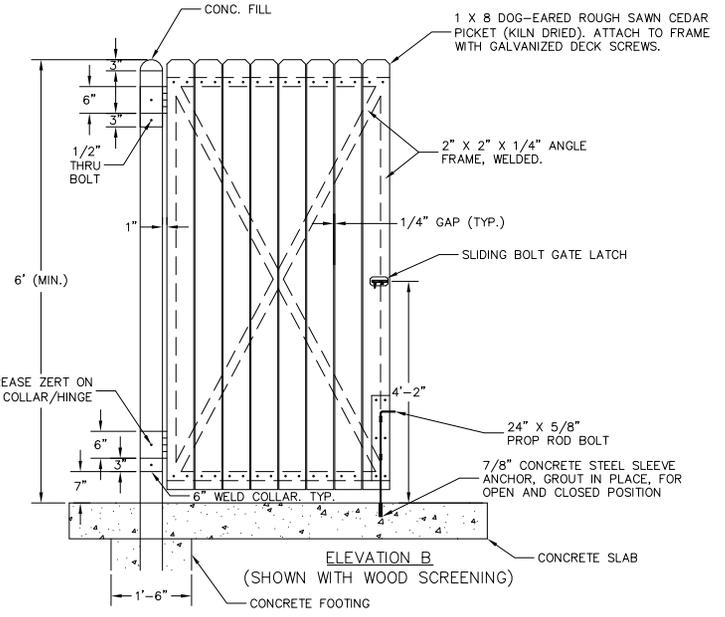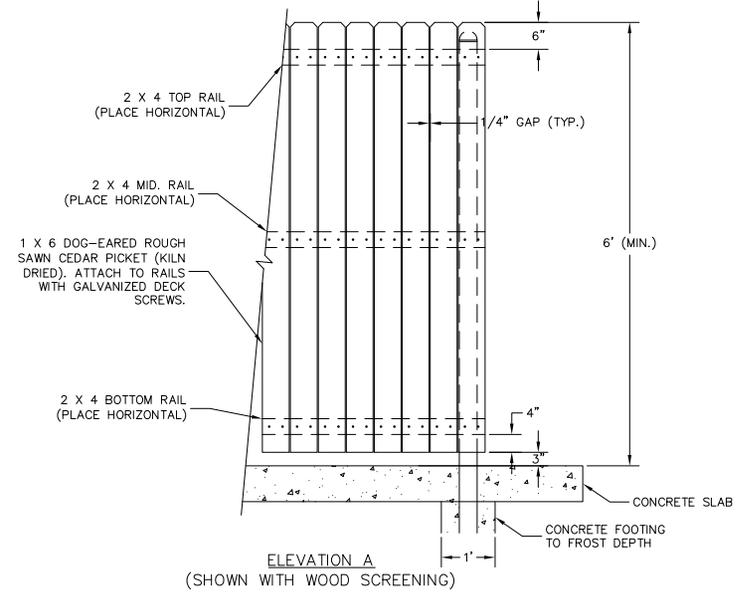

CITY OF KILLEEN
DEPARTMENT OF PUBLIC WORKS
 CONSTRUCTION STANDARDS AND DETAILS

DUMPSTER PAD
DETAIL

ISSUE DATE: 01-22-13	SCALE:	SW-01
REVISED: 6-3-2019	N.T.S.	